


**57-**

**Delayed Egress  
Exit Device  
Installation Instructions**

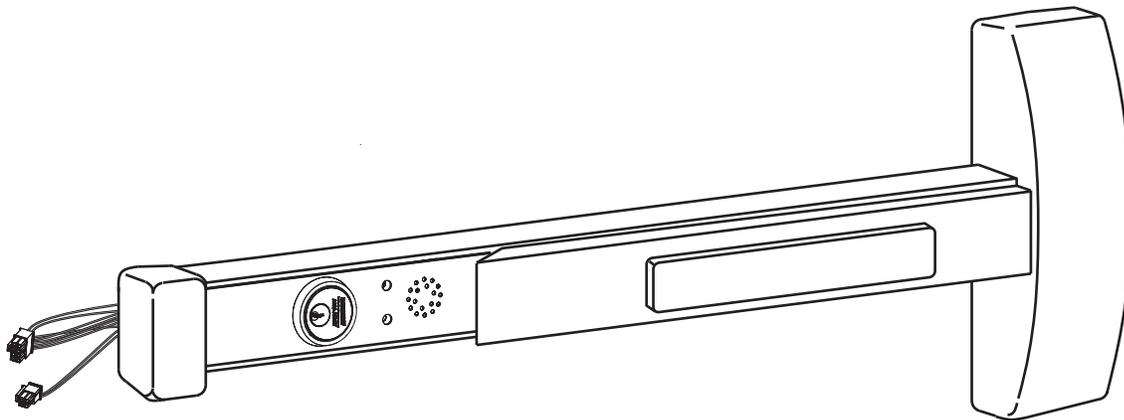

**For installation assistance, contact SARGENT at 800-810-WIRE (9473)**

A7743E

02/16

# Table of Contents

<b>1</b>	<b>Warning.....</b>	<b>3</b>
<b>2</b>	<b>General Description.....</b>	<b>4</b>
<b>3</b>	<b>Parts Breakdown.....</b>	<b>4</b>
<b>4</b>	<b>Installation Instructions.....</b>	<b>5</b>
<b>5</b>	<b>Factory Default Settings.....</b>	<b>9</b>
<b>6</b>	<b>Delayed Egress 57- Dip Switch Settings .....</b>	<b>10</b>
<b>7</b>	<b>Delayed Egress 57- Wiring.....</b>	<b>11</b>
<b>8</b>	<b>Exit Device Plug-in Connector Installation.....</b>	<b>14</b>
<b>9</b>	<b>System Wiring Examples.....</b>	<b>15</b>
<b>10</b>	<b>Operating Instructions.....</b>	<b>18</b>
<b>11</b>	<b>Troubleshooting.....</b>	<b>21</b>



## ElectroLynx®

As part of their promise to provide innovative, fast and effective, and higher security solutions to their customers, ASSA ABLOY Group companies offer ElectroLynx, a universal quick-connect system that simplifies the electrification of the door opening.

ElectroLynx® is a registered trademark of ASSA ABLOY, Inc.

A7743E

02/16

## 1 Warning

Changes or modifications to this device not expressly approved by ASSA ABLOY could void the user's authority to operate the equipment.

### FCC:

This equipment has been tested and found to comply with the limits for a Class B digital device, pursuant to Part 15 of the FCC Rules. These limits are designed to provide reasonable protection against harmful interference in a residential installation. This equipment generates, uses, and can radiate radio frequency energy and, if not installed and used in accordance with the instructions, may cause harmful interference to radio communications. However, there is no guarantee that interference will not occur in a particular installation. If this equipment does cause harmful interference to radio or television reception, which can be determined by turning the equipment off and on, the user is encouraged to try to correct the interference by one or more of the following measures:

- Reorient or relocate the receiving antenna.
- Increase the separation between the equipment and receiver.
- Connect the equipment into an outlet on a circuit different from that to which the receiver is connected.
- Consult the dealer or an experienced radio/TV technician for help.

### Industry Canada:

This Class B digital apparatus meets all requirements of the Canadian Interference Causing Equipment Regulations. Operation is subject to the following two conditions: (1) this device may not cause harmful interference, and (2) this device must accept any interference received, including interference that may cause undesired operation.

Cet appareillage numérique de la classe B répond à toutes les exigences de l'interférence canadienne causant des règlements d'équipement. L'opération est sujette aux deux conditions suivantes: (1) ce dispositif peut ne pas causer l'interférence nocive, et (2) ce dispositif doit accepter n'importe quelle interférence reçue, y compris l'interférence qui peut causer l'opération peu désirée.

"This equipment complies with FCC radiation exposure limits set forth for an uncontrolled environment. This equipment should be installed and operated with minimum distance 20cm between the radiator and your body. This transmitter must not be co-located or operating in conjunction with any other antenna or transmitter."

Under Industry Canada regulations, this radio transmitter may only operate using an antenna of a type and maximum (or lesser) gain approved for the transmitter by Industry Canada. To reduce potential radio interference to other users, the antenna type and its gain should be so chosen that the equivalent isotropically radiated power (e.i.r.p.) is not more than that necessary for successful communication.

Conformément à la réglementation d'Industrie Canada, le présent émetteur radio peut fonctionner avec une antenne d'un type et d'un gain maximal (ou inférieur) approuvé pour l'émetteur par Industrie Canada. Dans le but de réduire les risques de brouillage radioélectrique à l'intention des autres utilisateurs, il faut choisir le type d'antenne et son gain de sorte que la puissance isotrope rayonnée équivalente (p.i.r.e.) ne dépasse pas l'intensité nécessaire à l'établissement d'une communication satisfaisante.



Any retrofit or other field modification to a fire rated opening can potentially impact the fire rating of the opening, and SARGENT Manufacturing makes no representations or warranties concerning what such impact may be in any specific situation. When retrofitting any portion of an existing fire rated opening, or specifying and installing a new fire-rated opening, please consult with a code specialist or local code official (Authority Having Jurisdiction) to ensure compliance with all applicable codes and ratings.

### 2 General Description

The SARGENT 57-Delayed Egress Exit Device is designed to work with an external electromagnetic lock in areas that require a delayed egress which alarms at the door when any attempt is made to violate the door. The 57- device can be tied into a fire alarm system.

**NOTE:** Proper connections and appropriate peripheral hardware are required.

#### BC-Prefix Option

The BC prefix for 57- indicates that the unit has been programmed to comply with the section of the BOCA code relating to delayed egress.

BOCA allows for automatic reset of the delayed egress unit. Under BOCA, the unit can automatically reset thirty (30) seconds after the door has been cycled. If the door is opened any time during the thirty (30) seconds, the timer in the unit resets and waits another thirty (30) seconds before rearming. This requires a door position switch.

**Note: If a door position switch is not used (Blue wire connected to Black wire), the unit will automatically reset in 30 seconds.**


#### Electrical Specifications

- Input Voltage: 24VDC +/- 15% (20.4 - 27.6VDC) regulated/filtered
- Power Consumption @ 24VDC (with 1584 Electromagnet):
  - 60 mA (typical) Disarmed;
  - 220 mA (typical, unloaded) Armed;
  - 250 mA (typical) Delayed Egress Mode;
  - 375 mA (max, loaded) with Optional Features
- Operating Temp: 0°C to 49°C (32°F to 120°F)
- Maximum Electromagnetic Lock load: 275mA. If desired load exceeds this limit, an external relay module may be used.

All components must be installed according to prevailing electrical codes.

**There are no user serviceable parts on the 57- PCB module assembly.**


### 3 Parts Breakdown

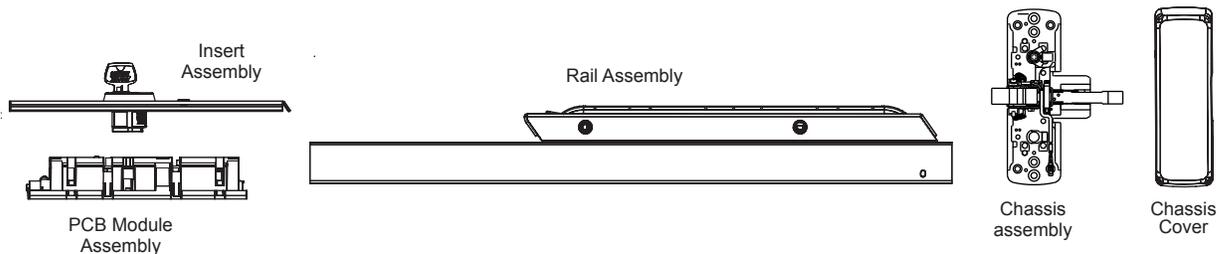

Part No.	Description
52-4830	PCB Module Replacement Pack - Standard
52-4831	PCB Module Replacement Pack - BOCA (BC prefix)
Consult factory	Rail Assembly
Consult factory	Chassis Assembly
Consult factory	Insert Assembly
Consult factory	Chassis Cover



## 4 Installation Instructions

1. Determine locations of components at the door
2. Mount all hardware and peripheral equipment according to manufacturer's instructions
  - NOTE: For exit device mechanical installation, refer to mechanical instruction sheets and templates included with product.**
3. Power supply should be mounted near door to avoid power drop due to excessive wire runs
4. Features used will determine wire requirements of electric hinge or other power transfer


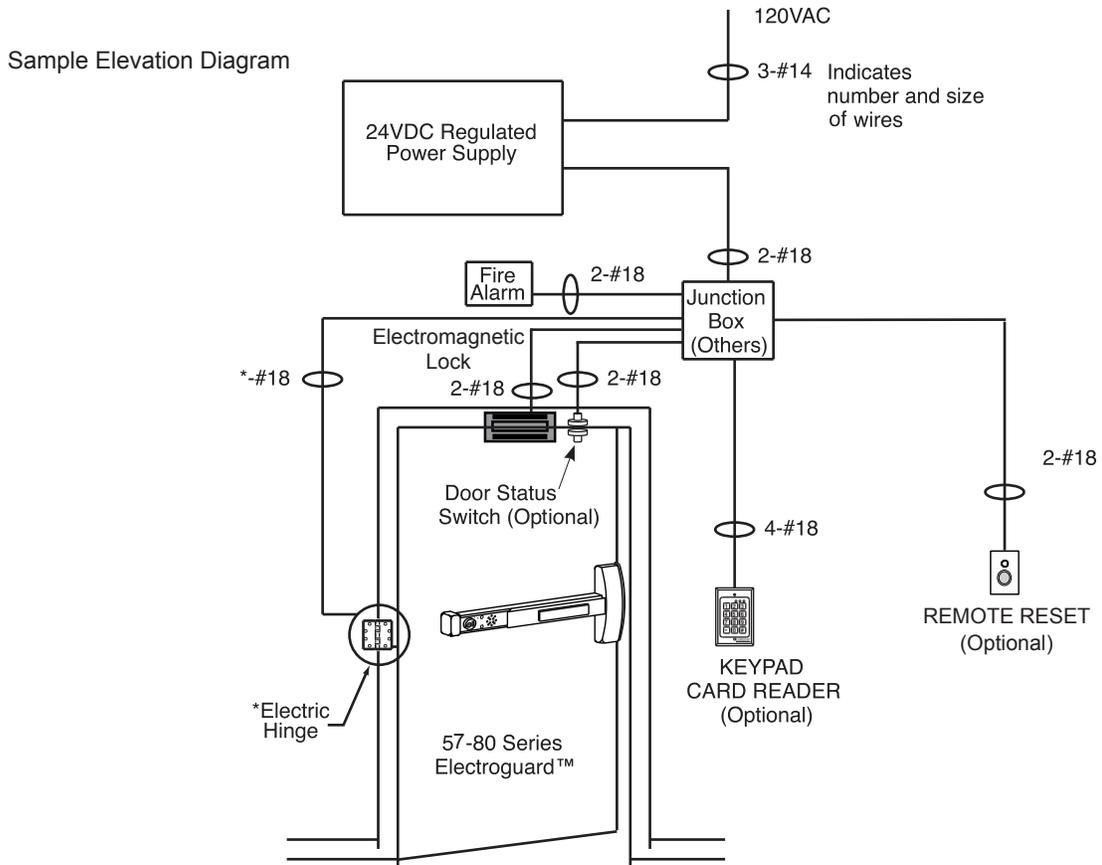


### 4 Installation Instructions (Continued)

Verify hand and bevel of door. Exit devices are always reverse bevel and are mounted on the inside of the door.

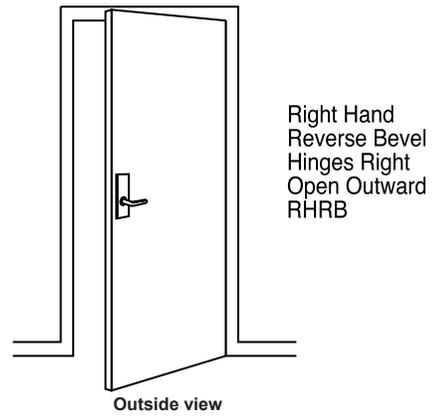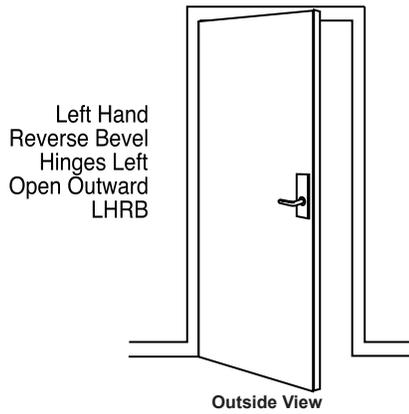

On inside of door, exit devices are oriented as follows:

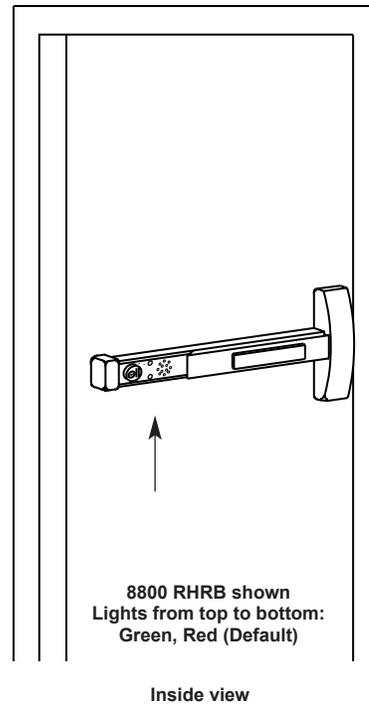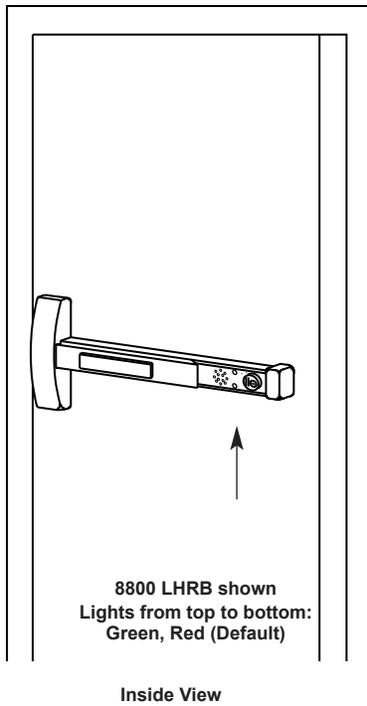

All subsequent illustrations in this document are shown as RHRB

## 4 Installation Instructions (Continued)


### ElectroLynx® Connector System Notes:

The system is designed to be installation friendly with pluggable connectors from the electric hinge through the door to the rail. The only wiring required is to the flying leads on the pigtail harness assembly on the frame side of the electric hinge.

### IMPORTANT:

The plug and receptacle connectors are designed to mate and lock together as shown in the figure. Plug the connectors into each other with the locking mechanism aligned as indicated.

**Do NOT force connectors on any other way**

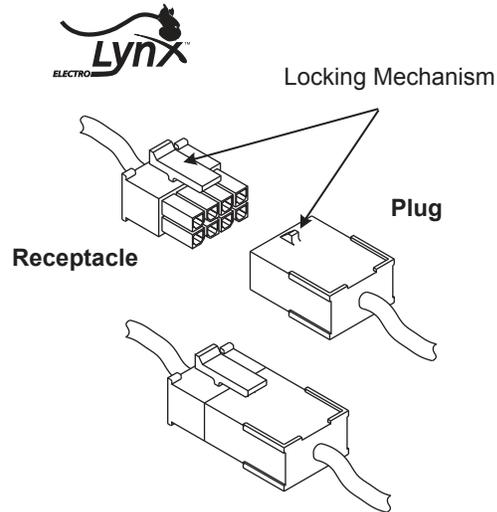

### 57- Exit Device - ElectroLynx Wiring Notes (Consult factory for assistance if required)

1. The ElectroLynx connector system is designed to be installation friendly with pluggable connectors from the electric hinge through the door to the rail. The rail, raceway, electric hinge, and pigtail harness connector terminations and wire colors all match.
2. For most applications, an 8-pin electric hinge is required.
3. Plug raceway connectors into ElectroLynx hinge connectors. Hard wire to corresponding pigtail harness wires as required.


### Installation Notes:

1. With new applications, a raceway harness with 8 & 4-pin connectors will be pre-installed inside the door by ASSA ABLOY door manufacturer when specified during the ordering process. Raceway harness kits are also available for retrofit applications. (For retrofit applications, refer to retrofit instructions)
2. If door does not have a raceway harness with connectors, either consult factory for raceway retrofit kit or cut connectors off product and hard wire, as required.
3. Wiring to pigtail harness is per facility wiring requirement. The rail, raceway, electric hinge and pigtail connector ( - +) terminations and wire colors all match.


### 4 Installation Instructions (Continued)

#### Cylinder Installation

1. Prepare door according to template(s) and instructions supplied with exit device.
2. Verify cylinder (size varies; consult factory) is installed in rail insert with collar prior to installing exit device on door.

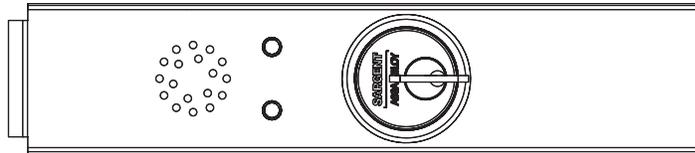

Top View of Insert

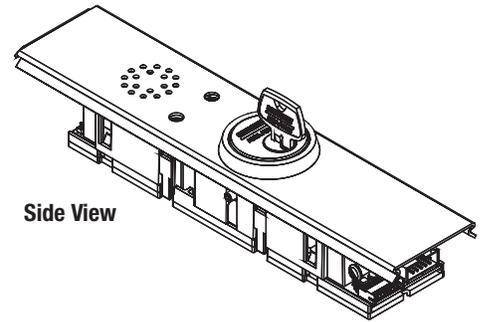


Side View

#### To Remove/Replace Cylinder

1. Ensure power is disconnected.
2. Loosen set screw by turning counter-clockwise using 5/64" allen wrench.
3. Extract and slide cylinder through spring and collar.

#### Note:


When replacing cylinder, slide cylinder through spring then collar, taking care to orient cylinder as shown. Hold cylinder into proper position and slowly tighten set screw until cylinder is securely held by set screw. Do NOT overtighten set screw.

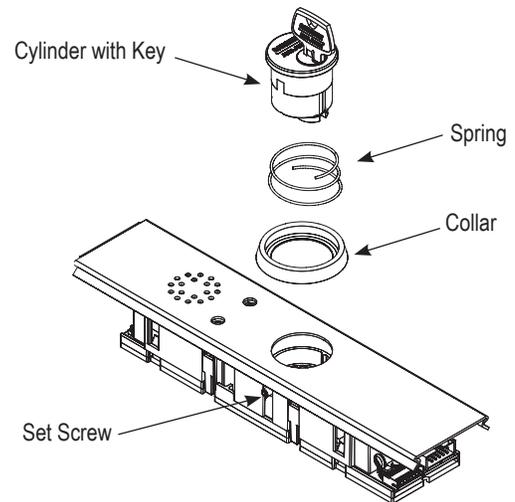

#### Cylinder Orientation

See illustration on circuit board for correct orientation of cylinder when installing.

**Note:** that proper position of cam allows for removal of key.

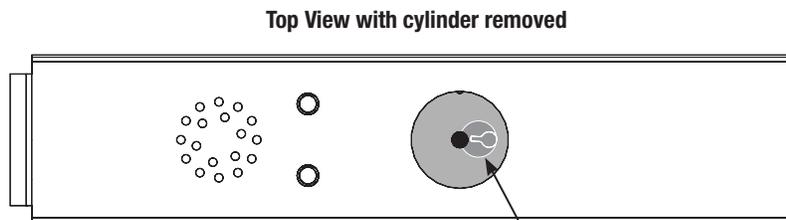


Top View with cylinder removed

Illustration (on circuit board)



Top of Cylinder

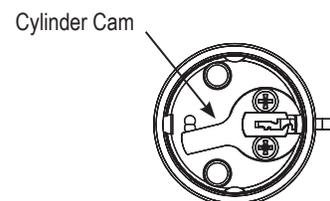

Bottom of Cylinder


## 5 Factory Default Settings

Default factory presets for the 57- are as follows:

Status	LEDs/Time	Horn
Armed (Delayed Egress)	Solid GREEN	Off
Momentary Egress (Passage Delay)	Flashing RED for (5) seconds	Off
Disarmed	Solid RED	Off
Alarm	Flashing RED & GREEN (15) seconds for egress	On
Nuisance Delay	(1) second	On
Nuisance Audible		On
Momentary Egress Time	(5) seconds	
Reverse LED	RED (Armed)	
Handing	"Top" LED (Armed) for LHRB or RHRB	

If default feature settings need to be changed, carefully slide the insert assembly from the rail assembly to make the proper DIP switch adjustments (see **Section 5 - DIP Switch Settings**).

For example, solid RED can be set to indicate that the rail is "Armed" with solid GREEN indicating that rail is "Disarmed".

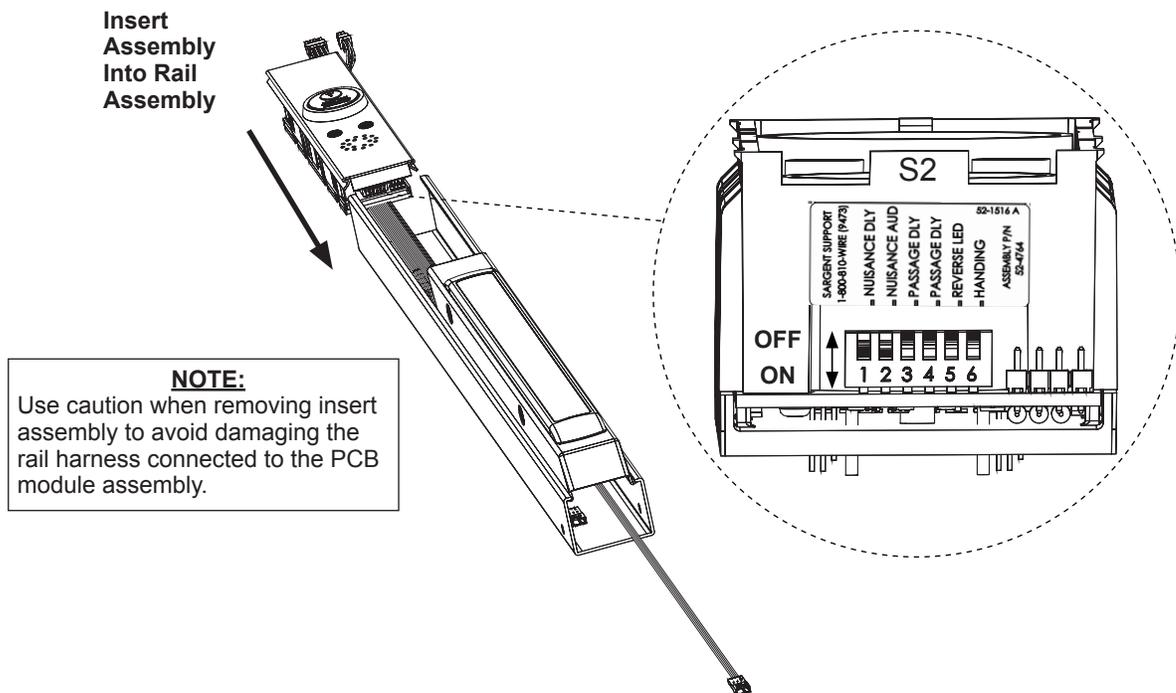

### 6 Delayed Egress 57- Dip Switch Settings

**S2-1 Nuisance Delay** - (Field selectable 0 or 1 second) A one second nuisance delay can be enabled by setting Dip Switch S2-1 to the “On” position. When nuisance delay is enabled, the unit will require the push bar to be depressed for more than one second in order to trigger an irreversible alarm condition. If the push bar is released before the 1 second has elapsed, the unit will go back into the “delayed egress mode” and the alarm will not sound. Nuisance delay is set to “On” position at factory.


If the Dip Switch S2-1 is in the “Off” position, there will be no nuisance delay and alarm horn will sound immediately when the push bar is depressed.

**S2-2 Nuisance Audible** - (Field selectable on or off) An audible horn is enabled by setting Dip Switch S2-2 to the “On” position. The internal horn will sound as soon as the push bar is depressed, signaling that the device is armed. If the pushbar is held down for more than 1 second, an irreversible alarm condition begins. If Dip Switch S2-2 is in the “Off” position, the horn will not sound during nuisance delay.

Nuisance audible is set to “On” position at factory to sound horn when rail is depressed during nuisance delay.


S2-1 On - (1) second Nuisance Delay

S2-1 Off - No Nuisance Delay





S2-2 On - Nuisance Audible On

S2-2 Off - Nuisance Audible Off



**S2-3 & S2-4 Momentary Egress Time** - Used to select the momentary egress time of 5, 10, 20 or 40 seconds. This switch is preset at the factory for five seconds.




S2 Dip Switch Position | Momentary Egress Time

S2-3	S2-4	Momentary Egress Time
OFF	OFF	5 seconds (Default)
OFF	ON	10 seconds
ON	OFF	20 seconds
ON	ON	40 seconds

**S2-5 Reverse LED** - Field selectable green or red. When S2-5 is “Off” the exit device LED is green when in armed mode (default) and red when in maintained or momentary egress mode. When S2-5 is “On” the exit device LED is red when in armed mode and green when in maintained or momentary egress.

S2-5 On - Red (Armed); Green (maintained or momentary egress)

S2-5 Off - Green (Armed); Red (maintained or momentary egress)



**S2-6 Handing** - Field selectable LHRB or RHRB. For a LHRB exit device S2-6 is “Off” for the top LED on the insert to be used when the device is armed. For a RHRB exit device S2-6 is “On” for the top LED on the insert to be used when the device is armed.

S2-6 Off - LHRB; Top LED indicates “Armed”

S2-6 On - RHRB; Top LED indicates “Armed”




## 7 Delayed Egress 57- Wiring

### A. IMPORTANT

**Caution: Disconnect all input power before beginning installation to prevent electrical shock and equipment damage.**

1. Installer must be a trained, experienced service person
2. All wiring must comply with applicable local electrical codes, ordinances and regulations
3. Field cut rail assemblies are not allowed. Exit device must be ordered for specific door width.

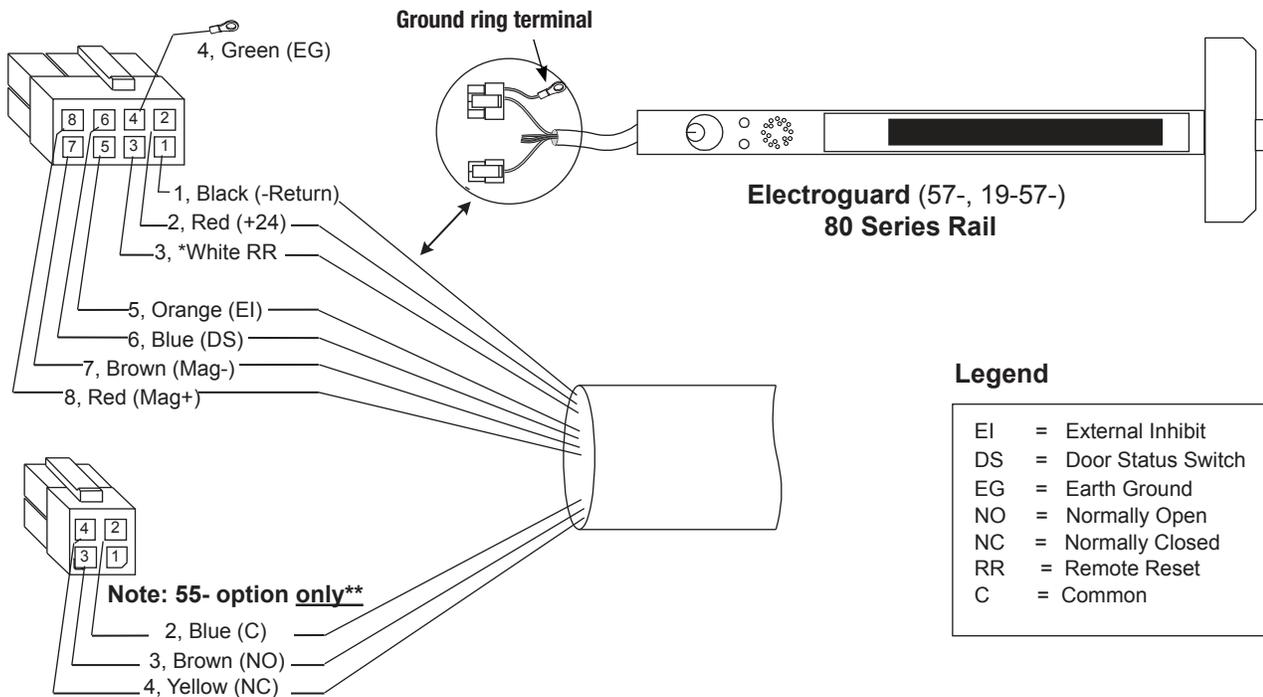

\* Note: White wire on previous Legacy product was used as Fire Alarm input option and has been replaced with RR.


### B. Installation Notes:

1. With new applications, a raceway harness with 8 & 4-pin connectors will be pre-installed inside the door by ASSA ABLOY door manufacturer when specified during the ordering process. Raceway harness kits are also available for retrofit applications. (For retrofit applications, refer to retrofit instructions)
2. If door does not have a raceway harness with connectors, either consult factory for raceway retrofit kit or cut connectors off product and hard wire, as required.
3. Wiring to pigtail harness is per facility wiring requirement. The rail, raceway, electric hinge and pigtail connector ( - +) terminations and wire colors all match.
4. \*\*55- only (option) Switch contact rating: 2A @ 30VDC.
5. **Tape or cap off ends of unused pigtail wires (not shown) to ensure that they do not short.**

### ASSA ABLOY

#### 7 Delayed Egress 57- Wiring (Continued)

The following are the input and output connector designations.				
Harness Connector Pin No.*	Circuit Board Pin No.	Input/ Output	Harness Wire Color	Function
8-2	J1-1	input	Red	+24VDC power
8-1	J1-2	input	Black	-Return
8-3	J1-4	input	White	Remote Reset
8-5	J1-5	input	Orange	External inhibit - disarm unit from i/s or o/s (key switch, card reader, keypad)
8-6	J1-6	input	Blue	Door position sensor (Door Status/Monitor)
<b>8-4</b>	<b>Chassis</b>	<b>Ground</b>	<b>Green</b>	<b>ESD (Earth) Ground</b>
8-7	J1-8	output	Brown	-Return Magnet -
8-8	J1-10	output	Red	+24VDC Magnet

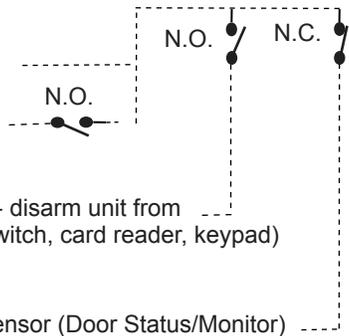


\*Example: 8-2 is the 8-pin connector position #2

## 7 Delayed Egress 57- Wiring (Continued)

Harness Connector Pin No.	I/O Circuit Board Pin No.	Function
8-2	J1-1	<b>24VDC Power Supply Input (+)</b> This input may be tied to the normally closed contact of a building's fire alarm system. If the fire alarm is activated, this contact will open, voiding the 15 second delay for egress.
8-1	J1-2	<b>Return</b> - Power Supply -return (-).
8-3	J1-4	<b>Remote Reset</b> - This input may be tied to a momentary normally open contact at a remote location to reset the device when in alarm. Additionally when the device is armed this input may be used for momentary egress with the time per the DIP switch settings. NOTE: Previous Fire Alarm Input option has been replaced with Remote Reset.
8-4	Chassis Ground	<b>Chassis Ground</b> - The chassis ground wire must terminate at earth ground of the equipment power supply or the main power source.
8-5	J1-5	<b>External Inhibit Input</b> - Used to provide remote override of the delayed egress when in the armed condition. Most common external inhibits are: card readers, keypad, key switches, or remote control console. More than one external inhibit device must be wired in parallel.
8-6	J1-6	<b>Door Position Sensor</b> - An external door status switch can be connected to the 57- to provide additional security. If the door status switch is utilized, an irreversible alarm will sound if the door is forced open while the device is armed. Unit will not arm if door is not shut. Once the irreversible alarm sounds, it will have to be reset at the door. If the door status switch is not utilized, connect the Blue wire to Return (Black wire) of the 5-pin harness.
8-7 8-8		<b>Return Magnet - +24VDC Output Magnet</b> External Magnet Connection - This output can supply up to 275mA load to an external magnet. This output may be connected to a 24VDC relay module if load shall exceed 275mA.

Copyright © 2016, Sargent Manufacturing Company, an ASSA ABLOY Group company. All rights reserved. Reproductions in whole or in part without express written permission of Sargent Manufacturing Company is prohibited.

### 8 Exit Device Plug-in Connector Installation

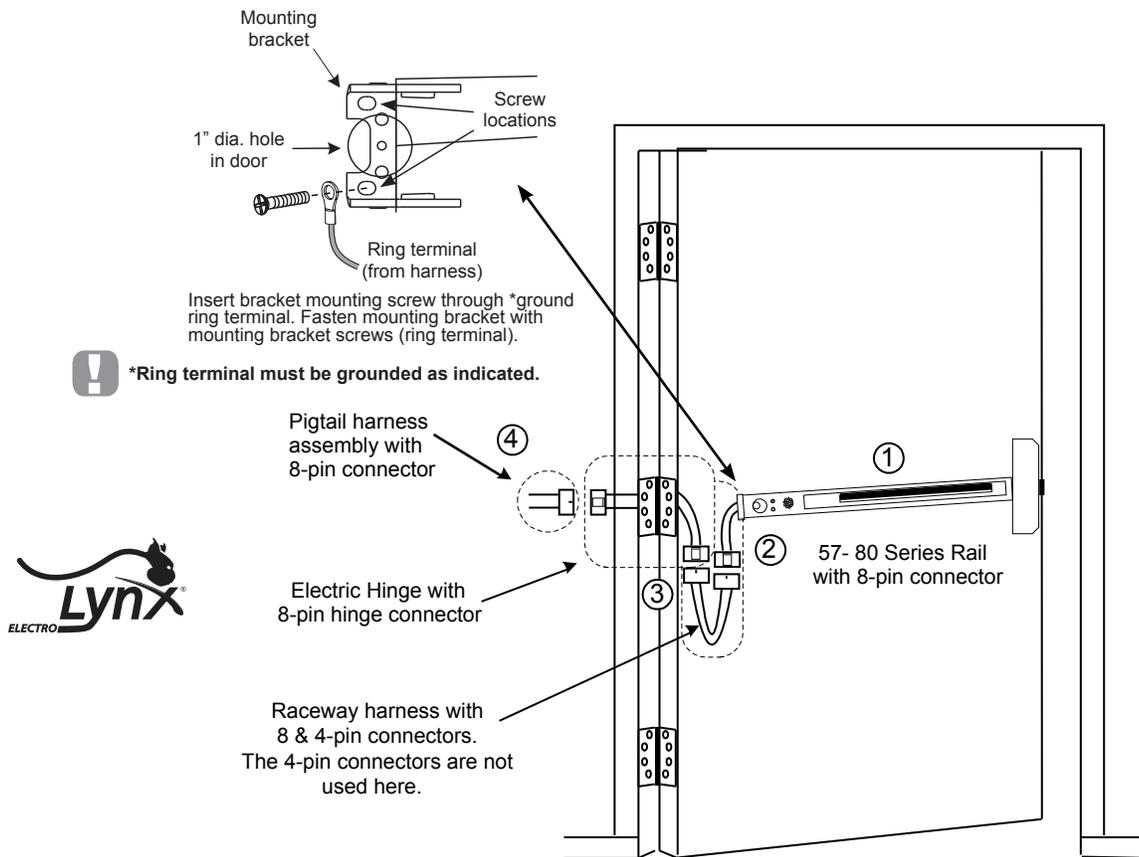


**Note:** No field rail cutoff allowed. Exit device must be ordered for specific door width.

- ① Mount exit device per instruction sheet provided.  
To insure trouble free operation, check that the push rail can be fully depressed. On vertical rod exit devices, check that the latch bolts do not go into hold back position until the push rail is fully depressed.
- ② Plug rail connector into raceway connector then feed through 1" hole in door. Install rail mounting bracket with two screws supplied. Install rail end cap.
- ③ Plug raceway connector into electric hinge connector then feed through door prep. Mount electric hinge to door.
- ④ Go to (A) if wiring now. Go to (B) if wiring is to be done later.
  - A. Refer to sections 8 and 9. Wire loose frame side wires to loose wires on pigtail harness as required using connectors allowed by local code. Plug pigtail harness connector into electric hinge connector. Feed harnesses through frame prep and mount electric hinge. Refer to operating instructions in section 10. Apply power and test exit device.
  - B. Plug pigtail harness connector into electric hinge connector. Feed harnesses through frame prep and mount electric hinge.

### 9 System Wiring Examples

#### Sample Wiring #1 – Basic 57- Delayed Egress with Fire Alarm and Remote Reset

During a fire alarm condition, the fire alarm contact opens which de-energizes the rail magnet and allows immediate egress.

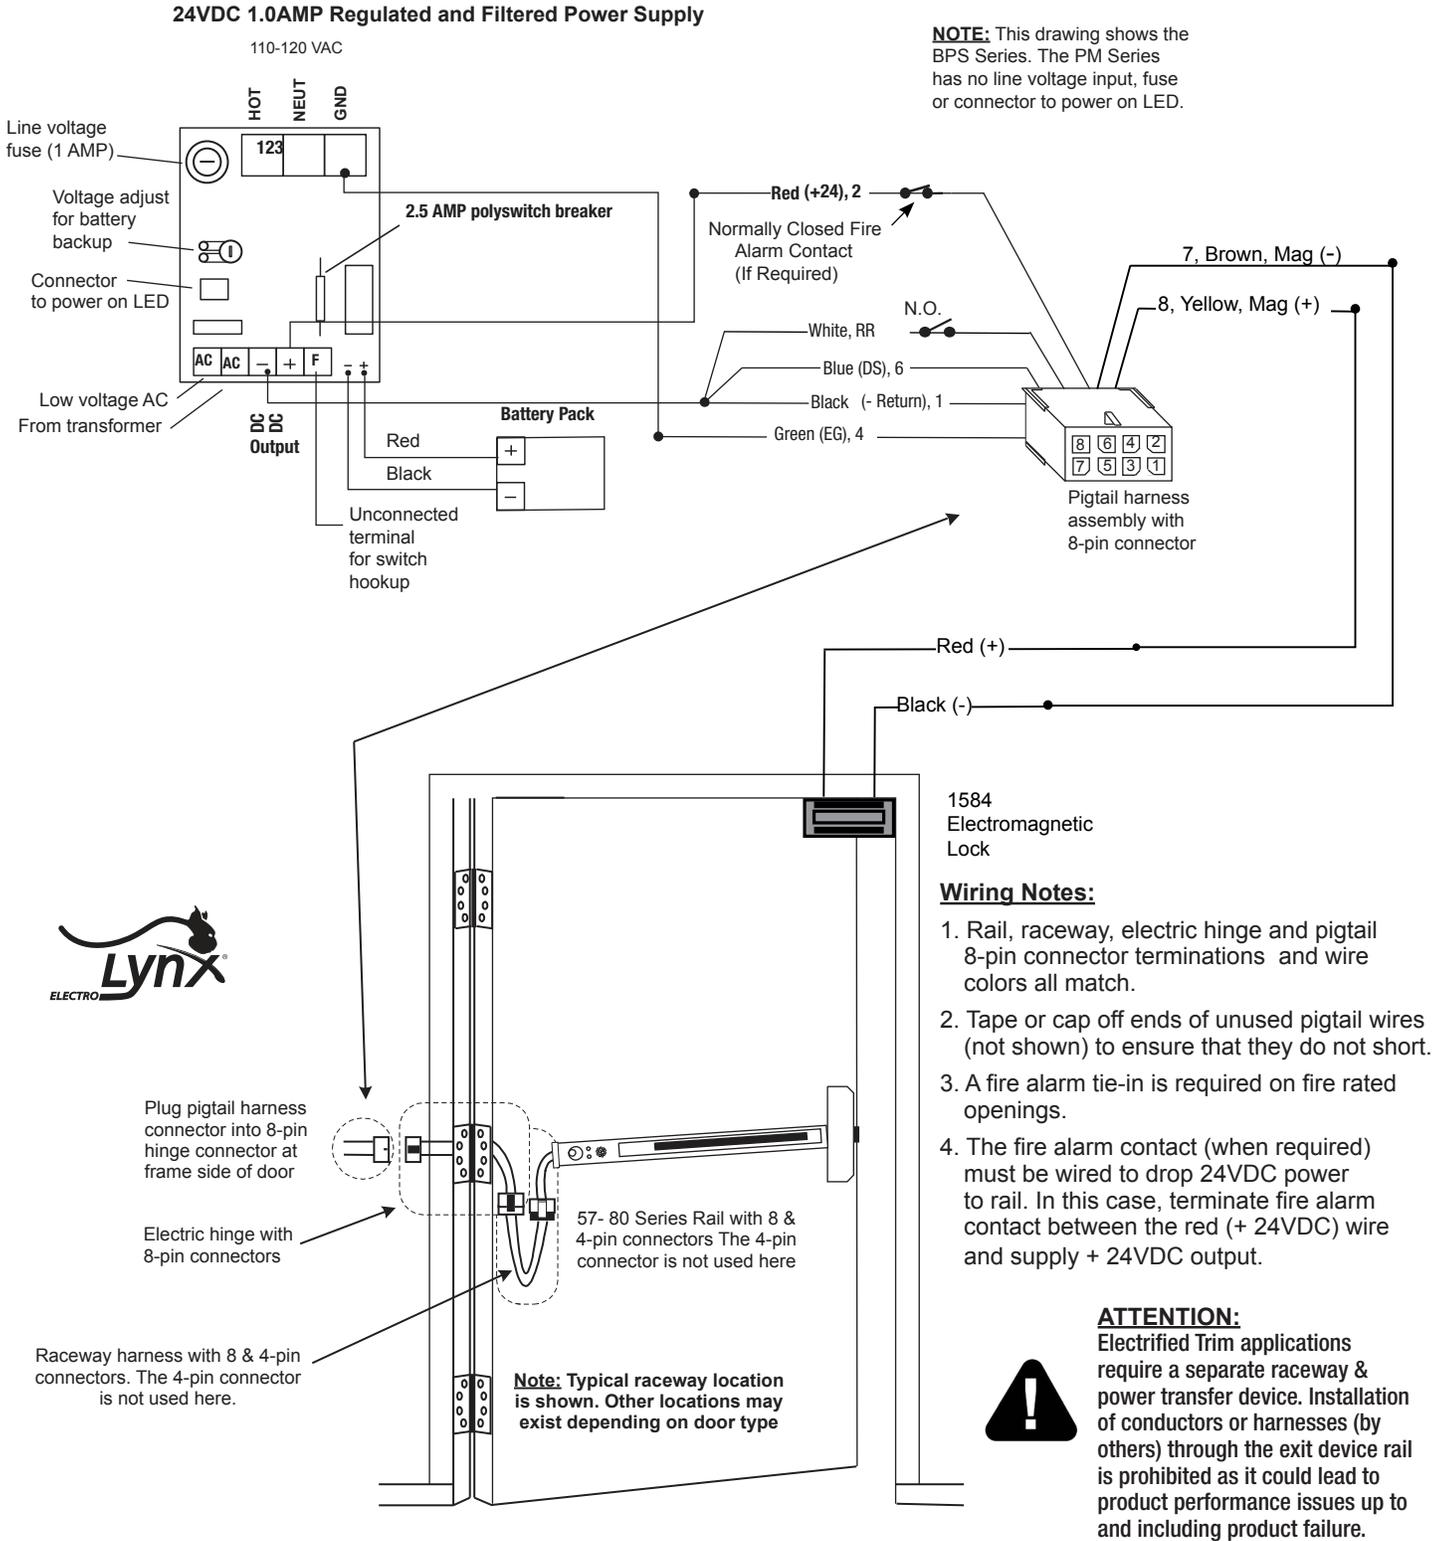

Copyright © 2016, Sargent Manufacturing Company, an ASSA ABLOY Group company. All rights reserved. Reproductions in whole or in part without express written permission of Sargent Manufacturing Company is prohibited.


02/29/16

### 9 System Wiring Examples (Continued)

#### Sample Wiring #2 – 57- Exit Device with inside Keypad, Fire Alarm, Door Status and Remote Horn

A valid code entry at the 4291 (Inside) keypad shunts the 57- exit device and allows egress for a time period programmable at the keypad. During a fire alarm condition, the contact opens which de-energizes the external electromagnet and allows immediate egress. When the rail is armed and the door is forced open, the 3287 door status switch signals the rail sounding the rail alarm.

#### 3520 24VDC 1.0AMP Regulated and Filtered Power Supply

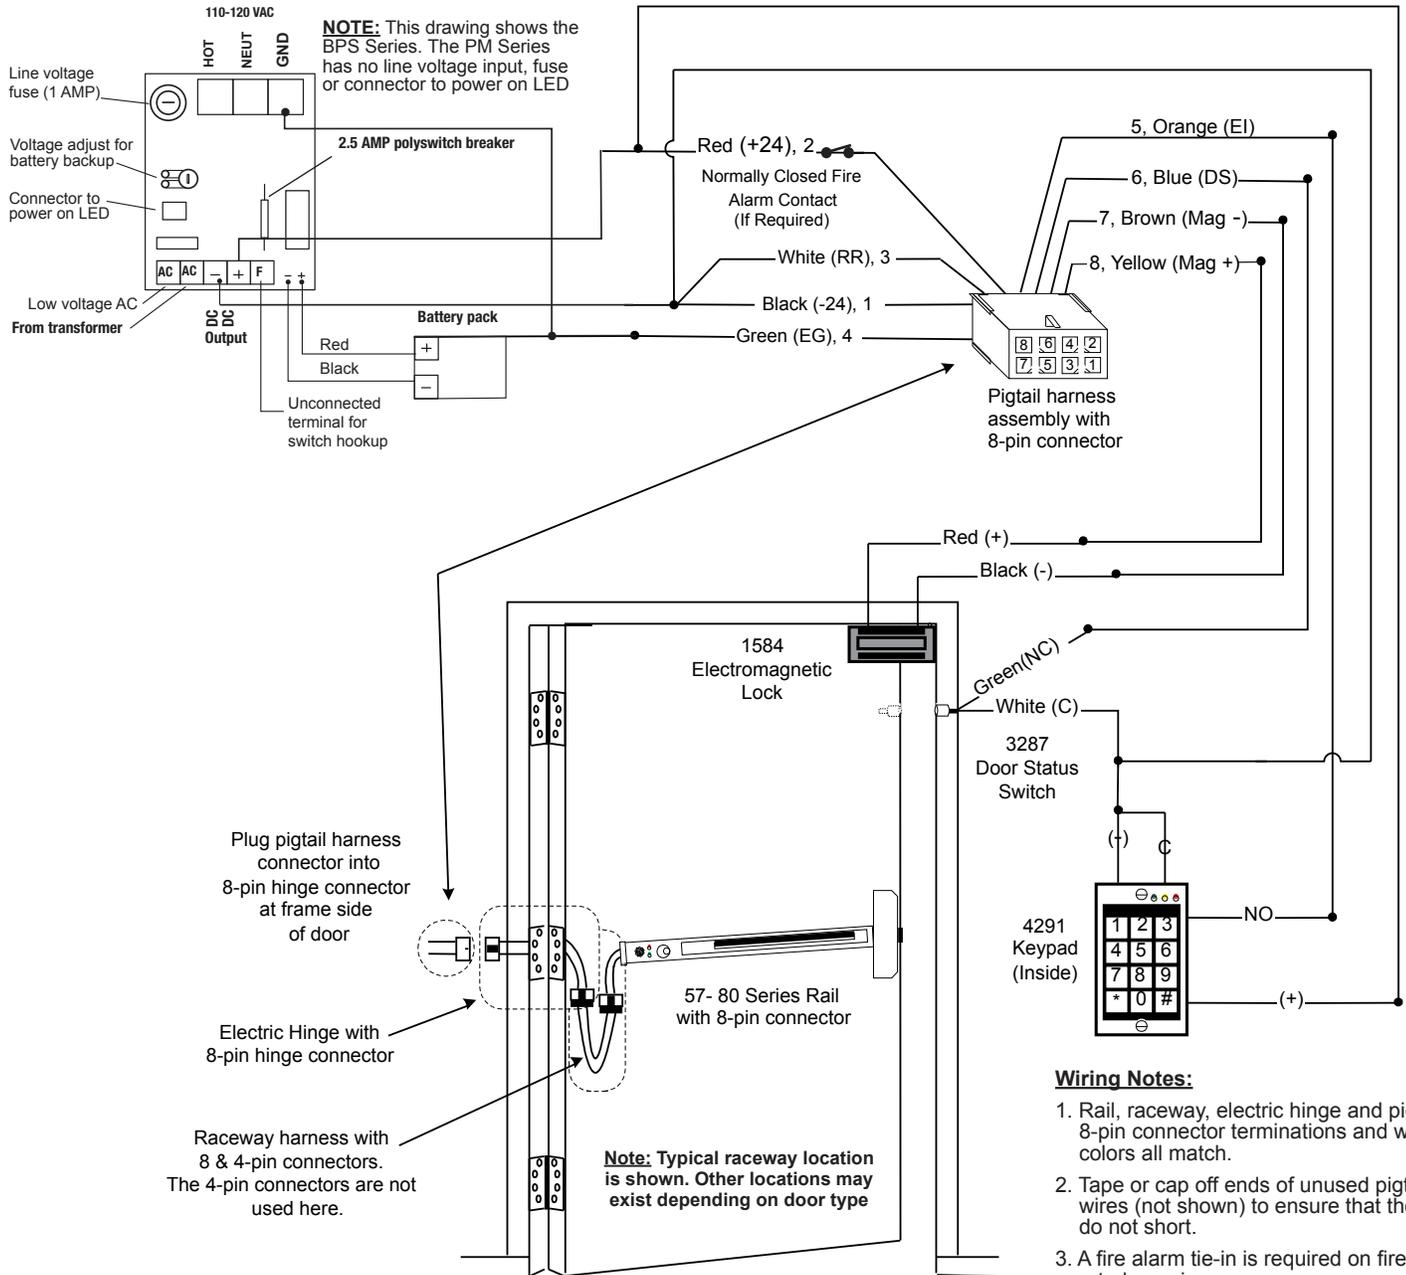

#### Wiring Notes:

1. Rail, raceway, electric hinge and pigtail 8-pin connector terminations and wire colors all match.
2. Tape or cap off ends of unused pigtail wires (not shown) to ensure that they do not short.
3. A fire alarm tie-in is required on fire rated openings.
4. The fire alarm contact (when required) must be wired to drop 24VDC power to rail. In this case, terminate fire alarm contact between the red (+ 24VDC) wire and supply + 24VDC output.

#### ATTENTION:


Electrified Trim applications require a separate raceway & power transfer device. Installation of conductors or harnesses (by others) through the exit device rail is prohibited as it could lead to product performance issues up to and including product failure.



## 9 System Wiring Examples (Continued)

### Sample Wiring #3 – 57- Exit Device with Fire Alarm, Keypads and Fail Safe ET

During a fire alarm condition, the contact opens which de-energizes the rail electromagnet and allows immediate egress. A valid code entry at the 4291 (Inside) keypad shunts the 57- exit device and allows egress for a time period programmable at this keypad. A valid code entry at the 4292 (Outside) keypad unlocks the 773 or 775 Fail Safe ET and shunts the 57- exit device and allows ingress for a time period programmable at this keypad.

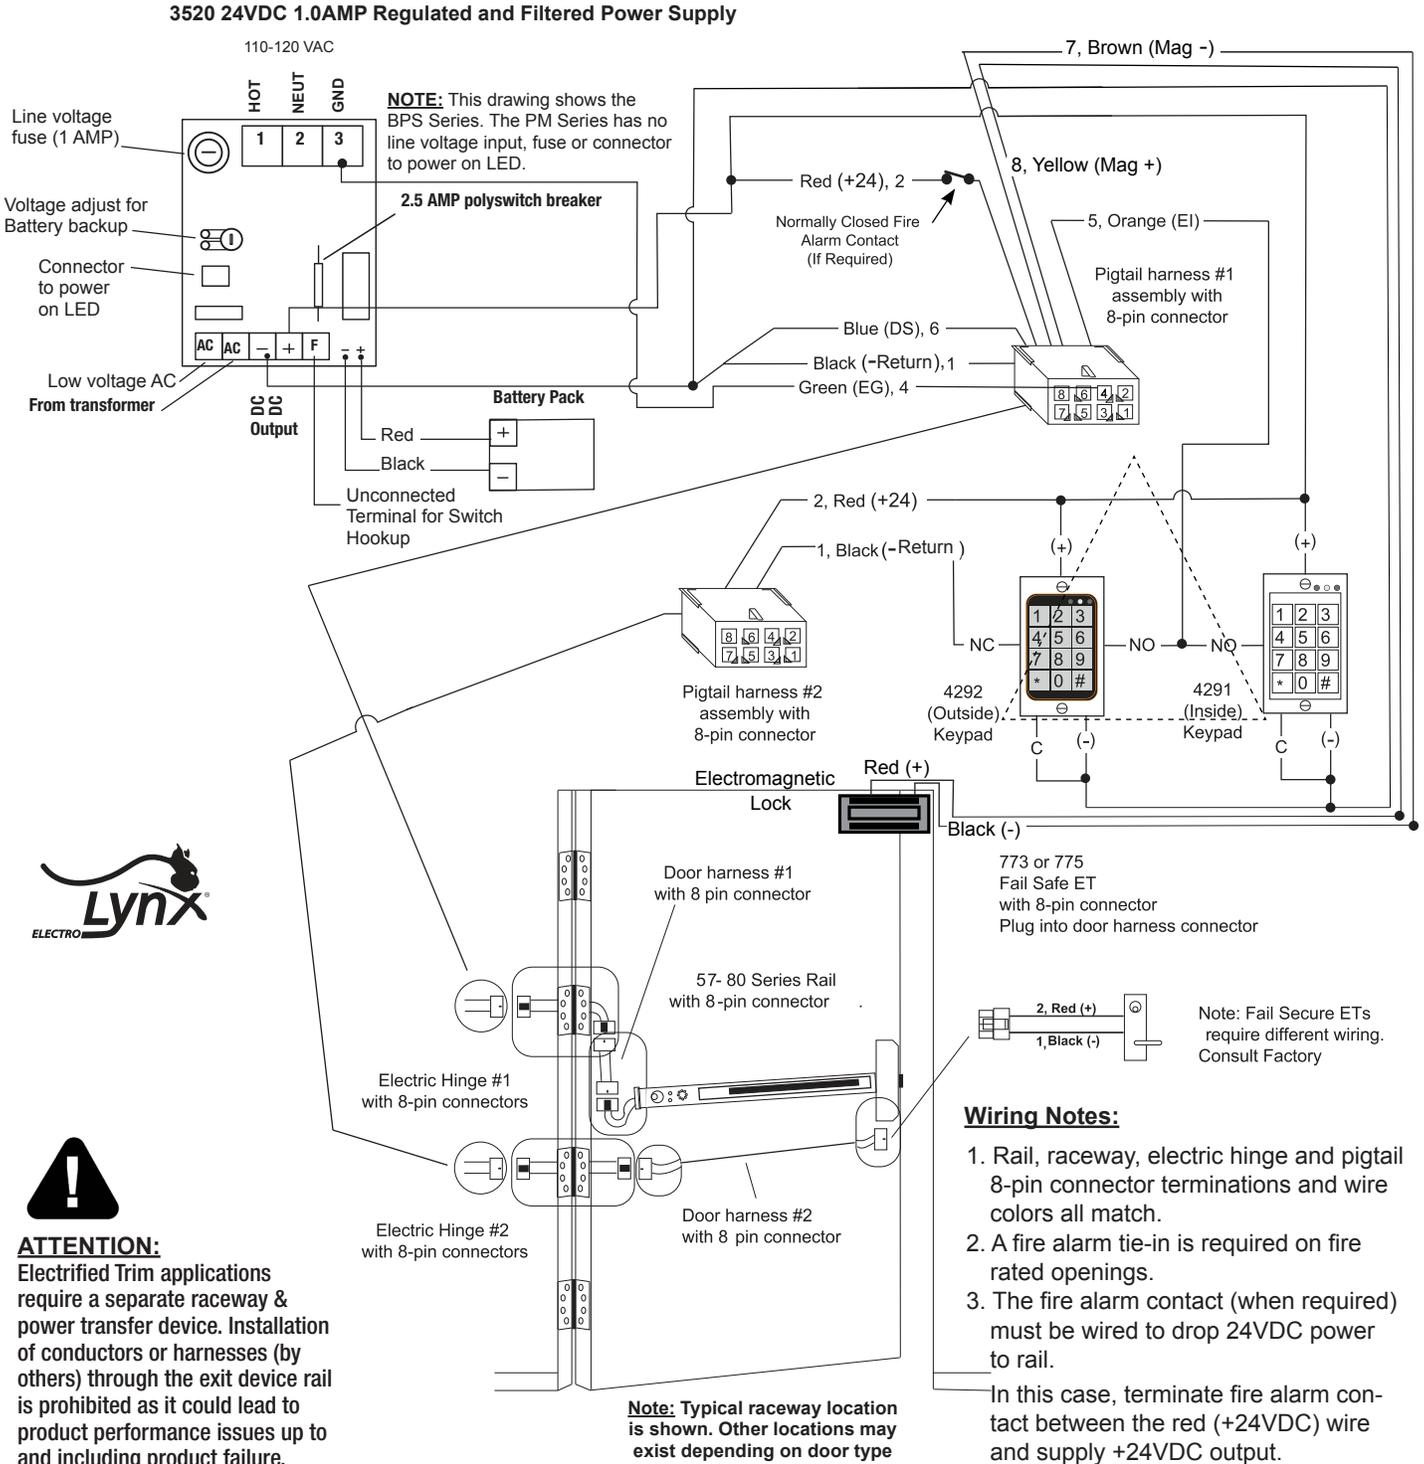

Copyright © 2016, Sargent Manufacturing Company, an ASSA ABLOY Group company. All rights reserved. Reproductions in whole or in part without express written permission of Sargent Manufacturing Company is prohibited.


### 10 Operating Instructions

**Note:** Power-up sequence is as follows:


- Both insert LEDs illuminate "red" for 2 seconds while concurrently sounding buzzer for 500ms.
- Both insert LEDs illuminate "green" for 2 seconds (no buzzer)
- The (4) *diagnostic* LEDs on bottom of module illuminate for 2 seconds.
- Insert LED illuminates to the switch position (armed or not armed).

There are three modes of operation: **Armed** (Delayed Egress), **Momentary Egress** and **Maintained Egress**.

These modes are set by fully inserting a valid key and rotating it in either a clockwise or counter-clockwise direction until there is a click (detent). Note that a second click must be engaged in order to set momentary egress. To remove the key, it must be returned to its original center position.

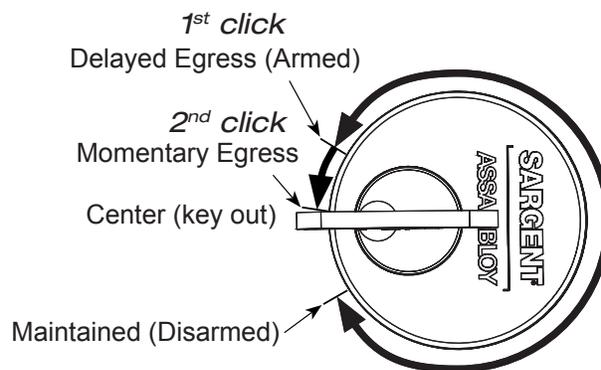


#### Armed Mode (Delayed Egress)

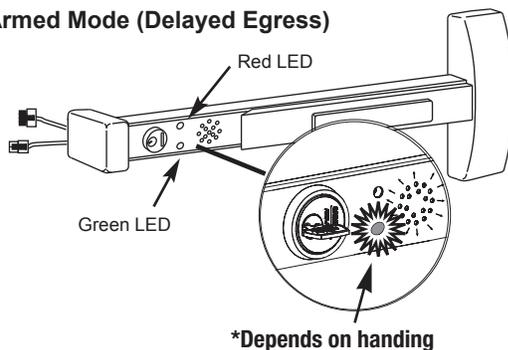

1. Apply power to the System; horn will sound for one second.
2. Both LEDs will flash RED, then both LEDs will flash GREEN.
3. Green (default) or Red LED on Electroguard™ insert will illuminate (See DIP switch settings section 7).
4. Rail assembly is armed. Latchbolt cannot be retracted by depressing the push rail for immediate egress. If rail is depressed for (min.) one second, alarm will sound.
5. If any of above sequence fails to function, the unit is not armed.

See: Troubleshooting section


#### Momentary Egress Mode

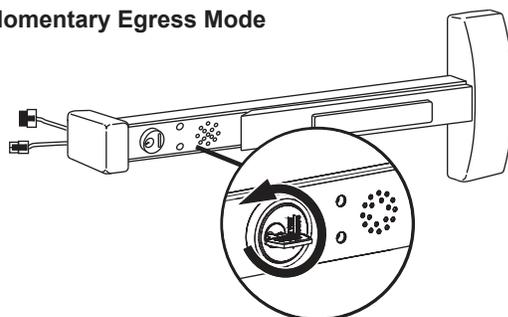

1. Rotate key counter-clockwise to 2nd click and return key to center position (key out).
2. Red (Default) or Green LED flashes on insert for a factory preset time of 5 seconds. (For other time selections and LED color, see Dip Switch Settings section 7). The rail assembly will disarm itself and de-energize the external magnet for this time period allowing for momentary egress.
3. After the factory preset time of 5 seconds, delay expires. Rail assembly re-arms itself and the external magnet is re-energized.
4. Unit is then in Delayed Egress Mode (or Power Up State).


## 10 Operating Instructions (Continued)

### Maintained Egress Mode

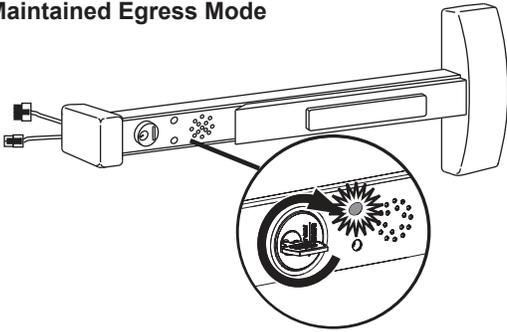


1. Rotate key fully clockwise (one click) and return key to center position (remove key).
2. Red (default) or Green LED will illuminate. See Dip Switch Settings section 5 for LED color settings.
3. Rail assembly is disarmed allowing the device to operate as a standard exit device permitting free egress.

### Resetting the Unit from Maintained Egress Mode to Armed Mode

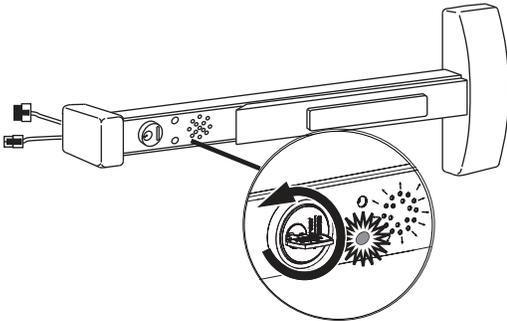

1. Rotate key counter-clockwise and return key to center position (remove key).
2. Maintained Red (Default) or Green LED de-energizes and Armed Green (default) or Red LED will illuminate.  
See Dip Switch Settings section 5.
3. The rail assembly re-arms itself into the Delayed Egress Mode. External electromagnetic lock is energized. Door is locked.

### While in the Delayed Egress Mode

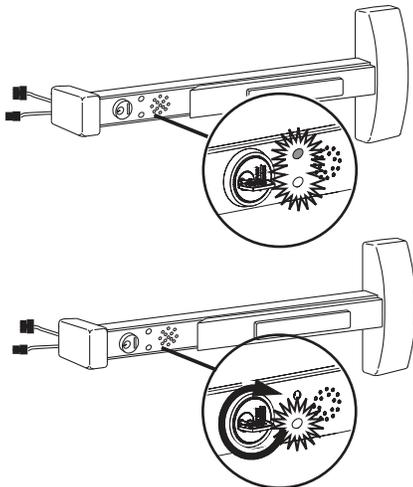


1. The rail assembly is armed - Green (default) or Red LED is illuminated, preventing immediate egress. See Dip Switch Settings section 5.
2. When the push rail is depressed for more than (1) second (nuisance delay), the alarm will sound and the Red and Green LEDs alternately flash. If there is no nuisance delay, alarm will sound immediately when push rail is depressed and the Red and Green LEDs will again flash alternately.
3. The alarm will continue to sound until the rail assembly is reset by inserting the key into the cylinder located on the mounting insert and rotating the key clockwise (one click) to return the unit to the armed mode.

**NOTE: A 57-BC-80 Series device automatically resets 30 seconds after door has been closed. (Requires door position switch).**

4. During first 15 seconds after alarm begins, the rail assembly remains armed and external electromagnet is locked, preventing immediate egress. After 15 seconds, the rail releases the external electromagnet, allowing egress.

**NOTE: The delayed egress time can be factory-set to 30 seconds. Local authority having jurisdiction (LHJ) prevails. Delay times may be regulated by local codes ordinances and regulations.**

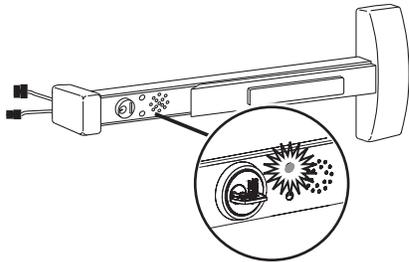**10 Operating Instructions (Continued)****Unit Tied Into A Fire Alarm System – Optional for Non-Labeled Devices**

1. In case of a fire/emergency, the rail assembly will release the external electromagnet instantaneously, voiding the 15 second delay, allowing immediate egress and continuous immediate egress.
2. LED will be extinguished and the rail will remain unlocked.
3. Once the fire alarm contact re-closes, the rail assembly automatically sets the unit into the armed mode, preventing immediate egress.

**NOTE:** Fire Alarm contact must be a normally closed (N.C.) contact.

**External Inhibit Input - Optional**

Used to provide remote override of the delayed egress unit when in an armed condition.

1. External inhibit is a normally open (N.O.) contact to common (-return).
2. If triggered, the unit is in an unarmed state for the duration of the time delay in the card reader, key switch or other external inhibit. Once the time delay from external inhibit device expires, the unit arms itself immediately.

**Remote Reset Input - Optional**

Used to provide remote reset when the delayed egress unit is in alarm and momentary egress when delayed egress unit is armed.

1. Remote reset input is a normally open (N.O.) contact to common (-return).
2. If triggered when unit is in alarm, the device is immediately reset to armed mode.
3. If triggered when unit is in armed mode, the device shall allow momentary egress for the time specified by the DIP switch settings then return to armed mode.

**Manual hex key dogging (non-fire rated) application note:**

If push bar is in the dogged (retracted) position when 24VDC power to rail is cycled (via fire alarm/reset or temporary power outage), the device will enter hall error mode "Both Insert LEDs flash rapid RED and GREEN". To clear this error mode, use the manual hex key to un-dog the push bar, ensure the push bar returns to the extended (home) position then turn the cylinder key CW to Maintained Egress mode then CCW to the center (Armed) position (or cycle 24VDC power to rail with cylinder key set to center - Armed position). The device should clear error mode and Arm.

## 11 Troubleshooting


The tables below are provided to assist in the installation and troubleshooting of the 57- exit device.

The following table lists the status and function of the (2) Green/Red LEDs located on the rail insert.

Visible Insert LEDs	Function
Green (Default) or Red ON only	Rail is Armed - Delayed Egress Mode
Red(Default) or Green ON only	Rail is Disarmed – Maintained (Free) Egress Mode
Red (Default) or Green “Flashing”	Rail is in Momentary Egress Mode
Green and Red “Alternate”, Rail Horn is ON	Rail is in violation

**IMPORTANT:** Always remove power to the rail before disconnecting or reconnecting connectors at the 57- PCB module assembly. Disconnect the 24VDC Power Supply or remove the Red (+24VDC) power wire at the rail.

The diagnostic LEDs are visible after install with end cap removed.

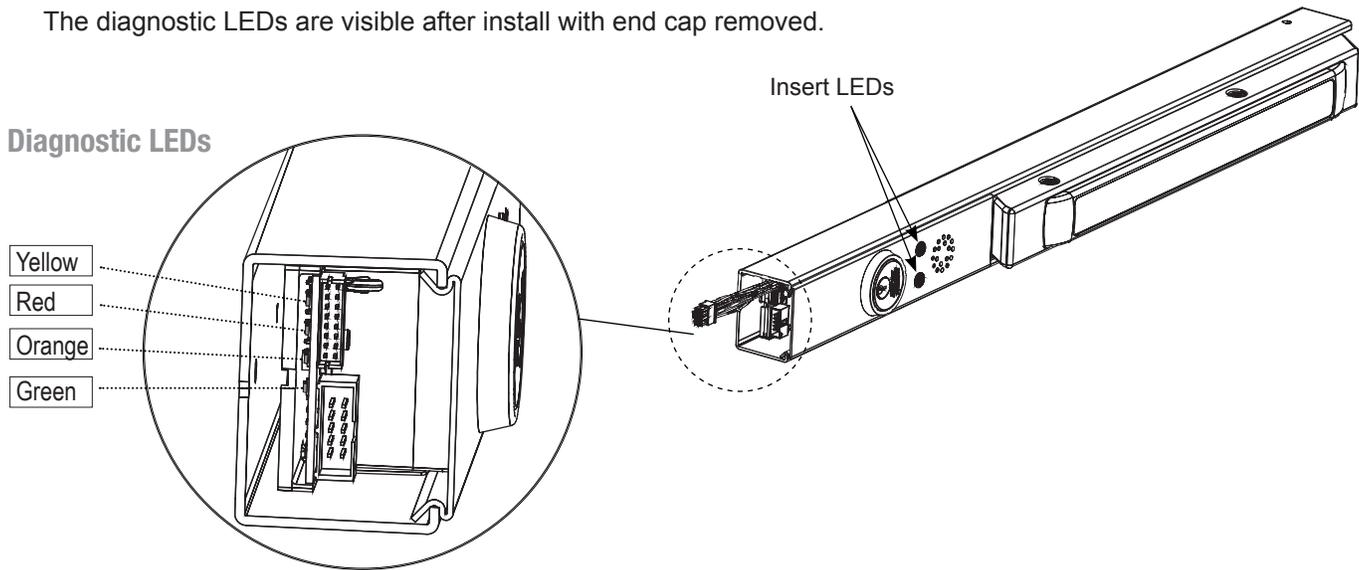

Refer to the following table and notes for an explanation of each LED's function.

Diagnostic LEDs	Function
Yellow (Latch Bolt/Rod Monitor)	ON – Latch Bolt or Vertical Rods are retracted OFF – Latch Bolt or Vertical Rods are extended/latched
Red (Push Rail Switch)	ON – Rail Push Bar is depressed OFF – Rail Push Bar is released
Orange (Door Status Switch)	ON – Door Status Switch is open. Door is open/violated OFF – Door Status Switch is closed. Door is closed and secure
Green (Magnet)	ON – Rail Magnet is energized (+24VDC from main board) OFF – Rail Magnet is de-energized


\*See Jumper position and function table on following page

### 11 Troubleshooting (Continued)

#### NOTES

With Rim, Mortise and Vertical Rod Exit Devices:


When jumper is missing or in wrong position, the Yellow Diagnostic LED turns ON. To locate (J5) jumper, remove Insert Assembly and Insert Assembly Plate:

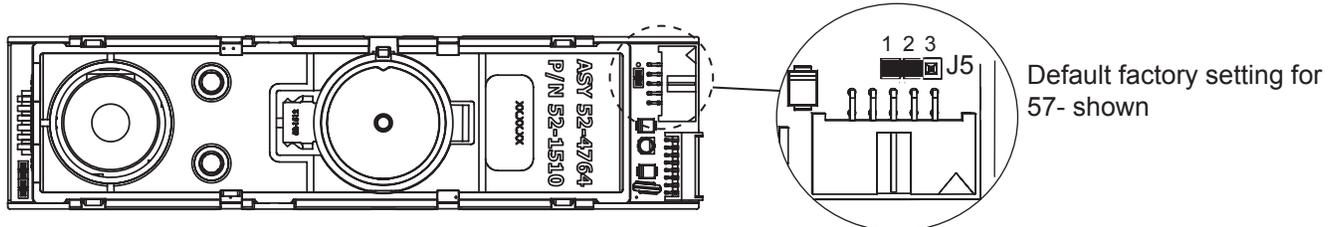

FUNCTION	JUMPER
57-	J5-1 & J5-2
59-STD	J5-2 & J5-3

1. When the rail is armed (in Delayed Egress Mode) and the door is closed and latched, the Green (default) or Red LED and the Green Diagnostic LED should be ON only. All other diagnostic LEDs should be OFF.
2. With the rail armed, depressing the rail push bar slightly will turn the Red Diagnostic LED ON. The rail should go into alarm immediately (no nuisance delay) or after being pressed in for 1 second (1-second nuisance delay). The rail will be in the irreversible alarm mode – Insert Green and Red LED flash and the rail horn sounds. After a standard delay of 15 seconds (or 30-second optional delay), the external magnet de-energizes and passage is allowed. The rail horn will continue to sound until the rail is reset either with a key or remotely.
3. When a Door Status switch is used and the door is opened the Orange Diagnostic LED will turn ON, which indicates that the door is not secure. When NOT using a Door Status switch, the Blue wire should be connected to Black (-Return). In this case, the LED will always be OFF.

#### MINIMUM REQUIREMENTS FOR ARMING RAIL (DELAYED EGRESS MODE)

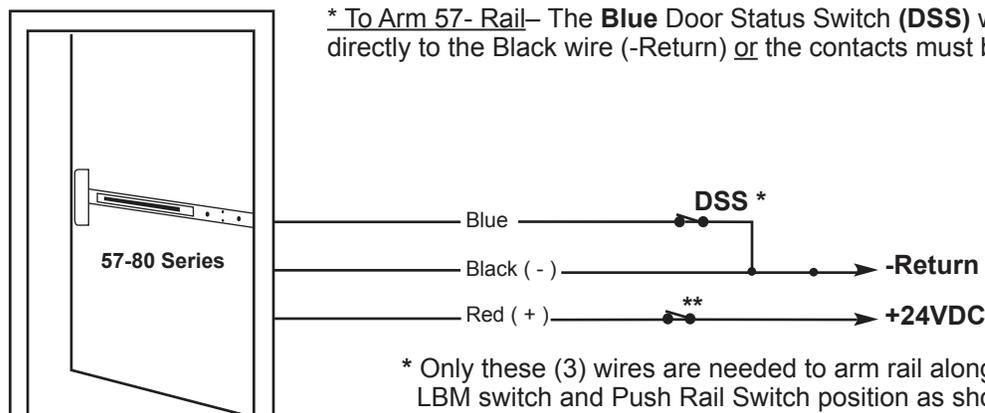

\* To Arm 57- Rail– The **Blue** Door Status Switch (**DSS**) wire must be connected directly to the Black wire (-Return) or the contacts must be closed as shown.

\* Only these (3) wires are needed to arm rail along with the correct LBM switch and Push Rail Switch position as shown before

\*\* Fire Alarm Contact (if required)

## 11 Troubleshooting (Continued)

### Symptom / Failure

\*Refer to Diagnostic LED Table/Description and Minimum Requirements to Arm Rail sections.

**A. Rail won't arm - (Armed LED won't turn ON / Horn sounds immediately or after a delay) -**

When trying to arm, the rail goes into alarm immediately after momentary egress times out or after a short delay after the momentary egress times out.

- Are the Yellow, Red and Orange Diagnostic LEDs OFF?

**YES** – Replace defective PCB module assembly.

**\*NO** – All of these LEDs should be OFF. Troubleshoot according to which LED is ON. If any LED stays ON after troubleshooting, consult 1-800-810-WIRE

**B. Rail won't arm - (Armed LED won't turn ON / Horn stays OFF) -**

- The rail is receiving an external inhibit signal

- The Orange wire is connected to Black wire (-Return) through external device or directly

- The rail is in fire alarm condition

**C. Rail arms, but the external electromagnet is not energized when pushbar is depressed - (Armed LED and Green Diagnostic LED are ON) -**

- Troubleshoot external electromagnet or external wiring. If wires can't be repaired, consult 1-800-810-WIRE

**D. Rail Arms, but will not go into alarm when depressing push bar -**

- Does the Red Diagnostic LED turn ON when depressing push bar?

**YES** – Replace defective PCB module assembly.

**NO** – The push rail hall switch is defective or out of activation range. If wires can't be repaired or if switch can't be adjusted (on rails which allow adjustment), consult **1-800-810-WIRE**.

**E. LEDs flash RED then GREEN in sequence approximately 0.25 seconds (\*Hall Error Mode). Horn and all diagnostic LEDs are off -**

- Rail may or may not arm prior to this error code

- Check harnesses are connected to controller PCBs

- Push rail hall switch circuit defective or out of activation range. Consult **1-800-810-WIRE (9473)**.

- If the push bar was in the dogged (retracted) position during a 24VDC power cycle (via fire alarm/reset or temporary power outage) this **hall error mode** will occur. To clear error un-dog push bar with manual hex key, ensure bar extends fully then turn cylinder key CW to Maintained Egress position then CCW to Armed (center) position (or cycle 24VDC power) to rearm device.

\*If horn sounds or flashing sequence differs from the above; or if error mode does not clear, consult **1-800-810-WIRE (9473)**



**IMPORTANT:** RAIL IS NOT ARMED WHEN IN THIS CONDITION!

**ATTENTION:**

Electrified Trim applications require a separate raceway & power transfer device. Installation of conductors or harnesses (by others) through the exit device rail is prohibited as it could lead to product performance issues up to and including product failure.

**SARGENT®**

**ASSA ABLOY**

SARGENT Manufacturing  
100 Sargent Drive  
New Haven, CT 06511 USA  
800-810-WIRE (9473) • [www.sargentlock.com](http://www.sargentlock.com)

*Founded in the early 1800s, SARGENT® is a market leader in locksets, cylinders, door closers, exit devices, electro-mechanical products and access control systems for new construction, renovation, and replacement applications. The company's customer base includes commercial construction, institutional, and industrial markets.*

*Copyright © 2016, Sargent Manufacturing Company, an ASSA ABLOY Group company. All rights reserved. Reproduction in whole or in part without the express written permission of Sargent Manufacturing Company is prohibited.*

*ASSA ABLOY is the global leader in door opening solutions, dedicated to satisfying end-user needs for security, safety and convenience.*